

Fixture Hydraulic Load Calculations


Complete the following to determine City Water Service Pipe Size and Private Water Service Pipe Size requirements (see over for instruction)

Table A - Fixture Hydraulic Load Calculation for Water Service Pipe Size: Single Family Dwelling, Garden Suites or Duplexes			
Indicate all buildings or areas serviced by your metered water connection. Each meter connection requires a separate form.			
<input type="checkbox"/> Single Family Dwelling <input type="checkbox"/> Duplex <input type="checkbox"/> Secondary Suite <input type="checkbox"/> Garden Suite			
Fixture or Device	Fixture Units (A)	Qty of Fixtures (B)	Load (A x B)
Bathroom Group - three fixtures only (1 toilet, 1 basin and 1 bathtub or 1 shower stall = 1 Bathroom group)	3.6		
Bathtub	1.4		
Clothes Washer	1.4		
Dishwasher	1.4		
Hose bibb – ½" (Outside Tap)	2.5		
Sink, bar	1		
Sink, Bathroom (Lavatory or Basin)	0.7		
Sink, kitchen	1.4		
Sink, laundry (1 or 2 compartments)	1.4		
Shower stall (1 shower valve)	1.4		
Water closet (Toilet)	2.2		
Use TOTAL to determine Size Requirements in Tables B and C		TOTAL LOAD =	

Table B - City Water Service Pipe Size (Street to Property Line)				
MAX ALLOWED TOTAL LOAD	Required Pipe Size	Select One	(Internal Use) PSR Initial	
			Existing	Required
16.4	Existing ½" (meter size)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
23.6	Existing ¾" (meter size)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
21	New ¾"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
43	1"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
146	1½"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Table C - Private Water Service Pipe (Private Property)				
MAX ALLOWED TOTAL LOAD	Required Pipe Size	Select One	Completed by Applicant	
			Existing	Required
7	½"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
16	¾"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
31	1"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
57	1¼"	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Water Service Pipe and Meter Size — SFD and Duplexes Diagram 1

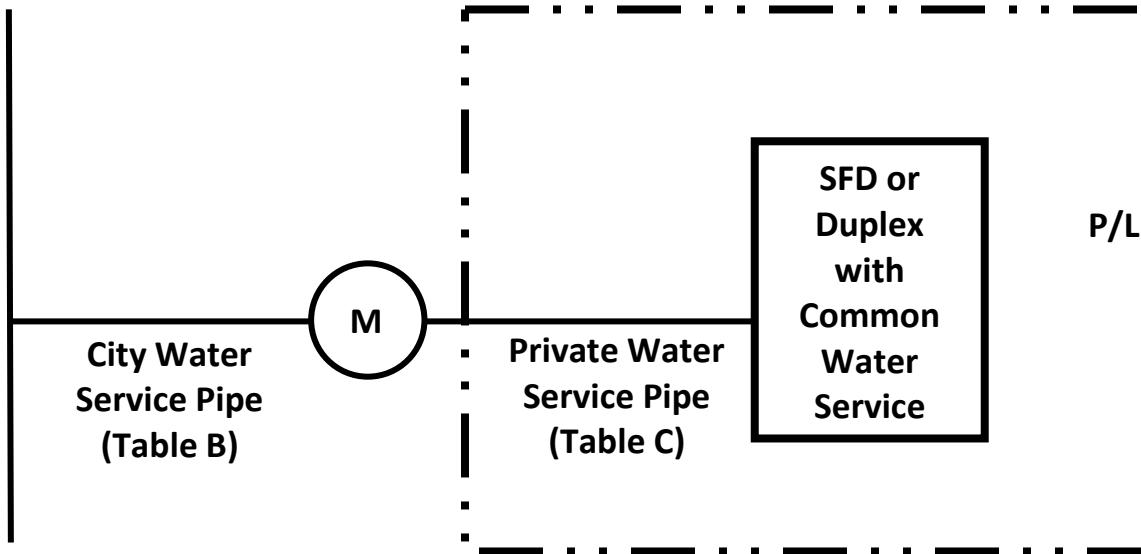

Sizing Procedure

1. Determine TOTAL LOAD value by completing Table A
2. Determine City Water Service Pipe Size requirements from Table B using TOTAL LOAD from Table A.
3. Determine Private Water Service Pipe Size requirements from Table C using TOTAL LOAD from Table A.

Note: When completing Table A, include ALL fixture units serviced by a single meter connection. This might include plumbing fixture unit loads for accessory buildings or other features on the property.

The personal information requested in this form is collected under section 26 (c) of the Freedom of Information and Protection of Privacy Act and will be used to administer permit applications within the City of Langford. Please contact the Building Department at 250-474-6692 or building@langford.ca if you have any questions about the collection, use, or disclosure of this information.